


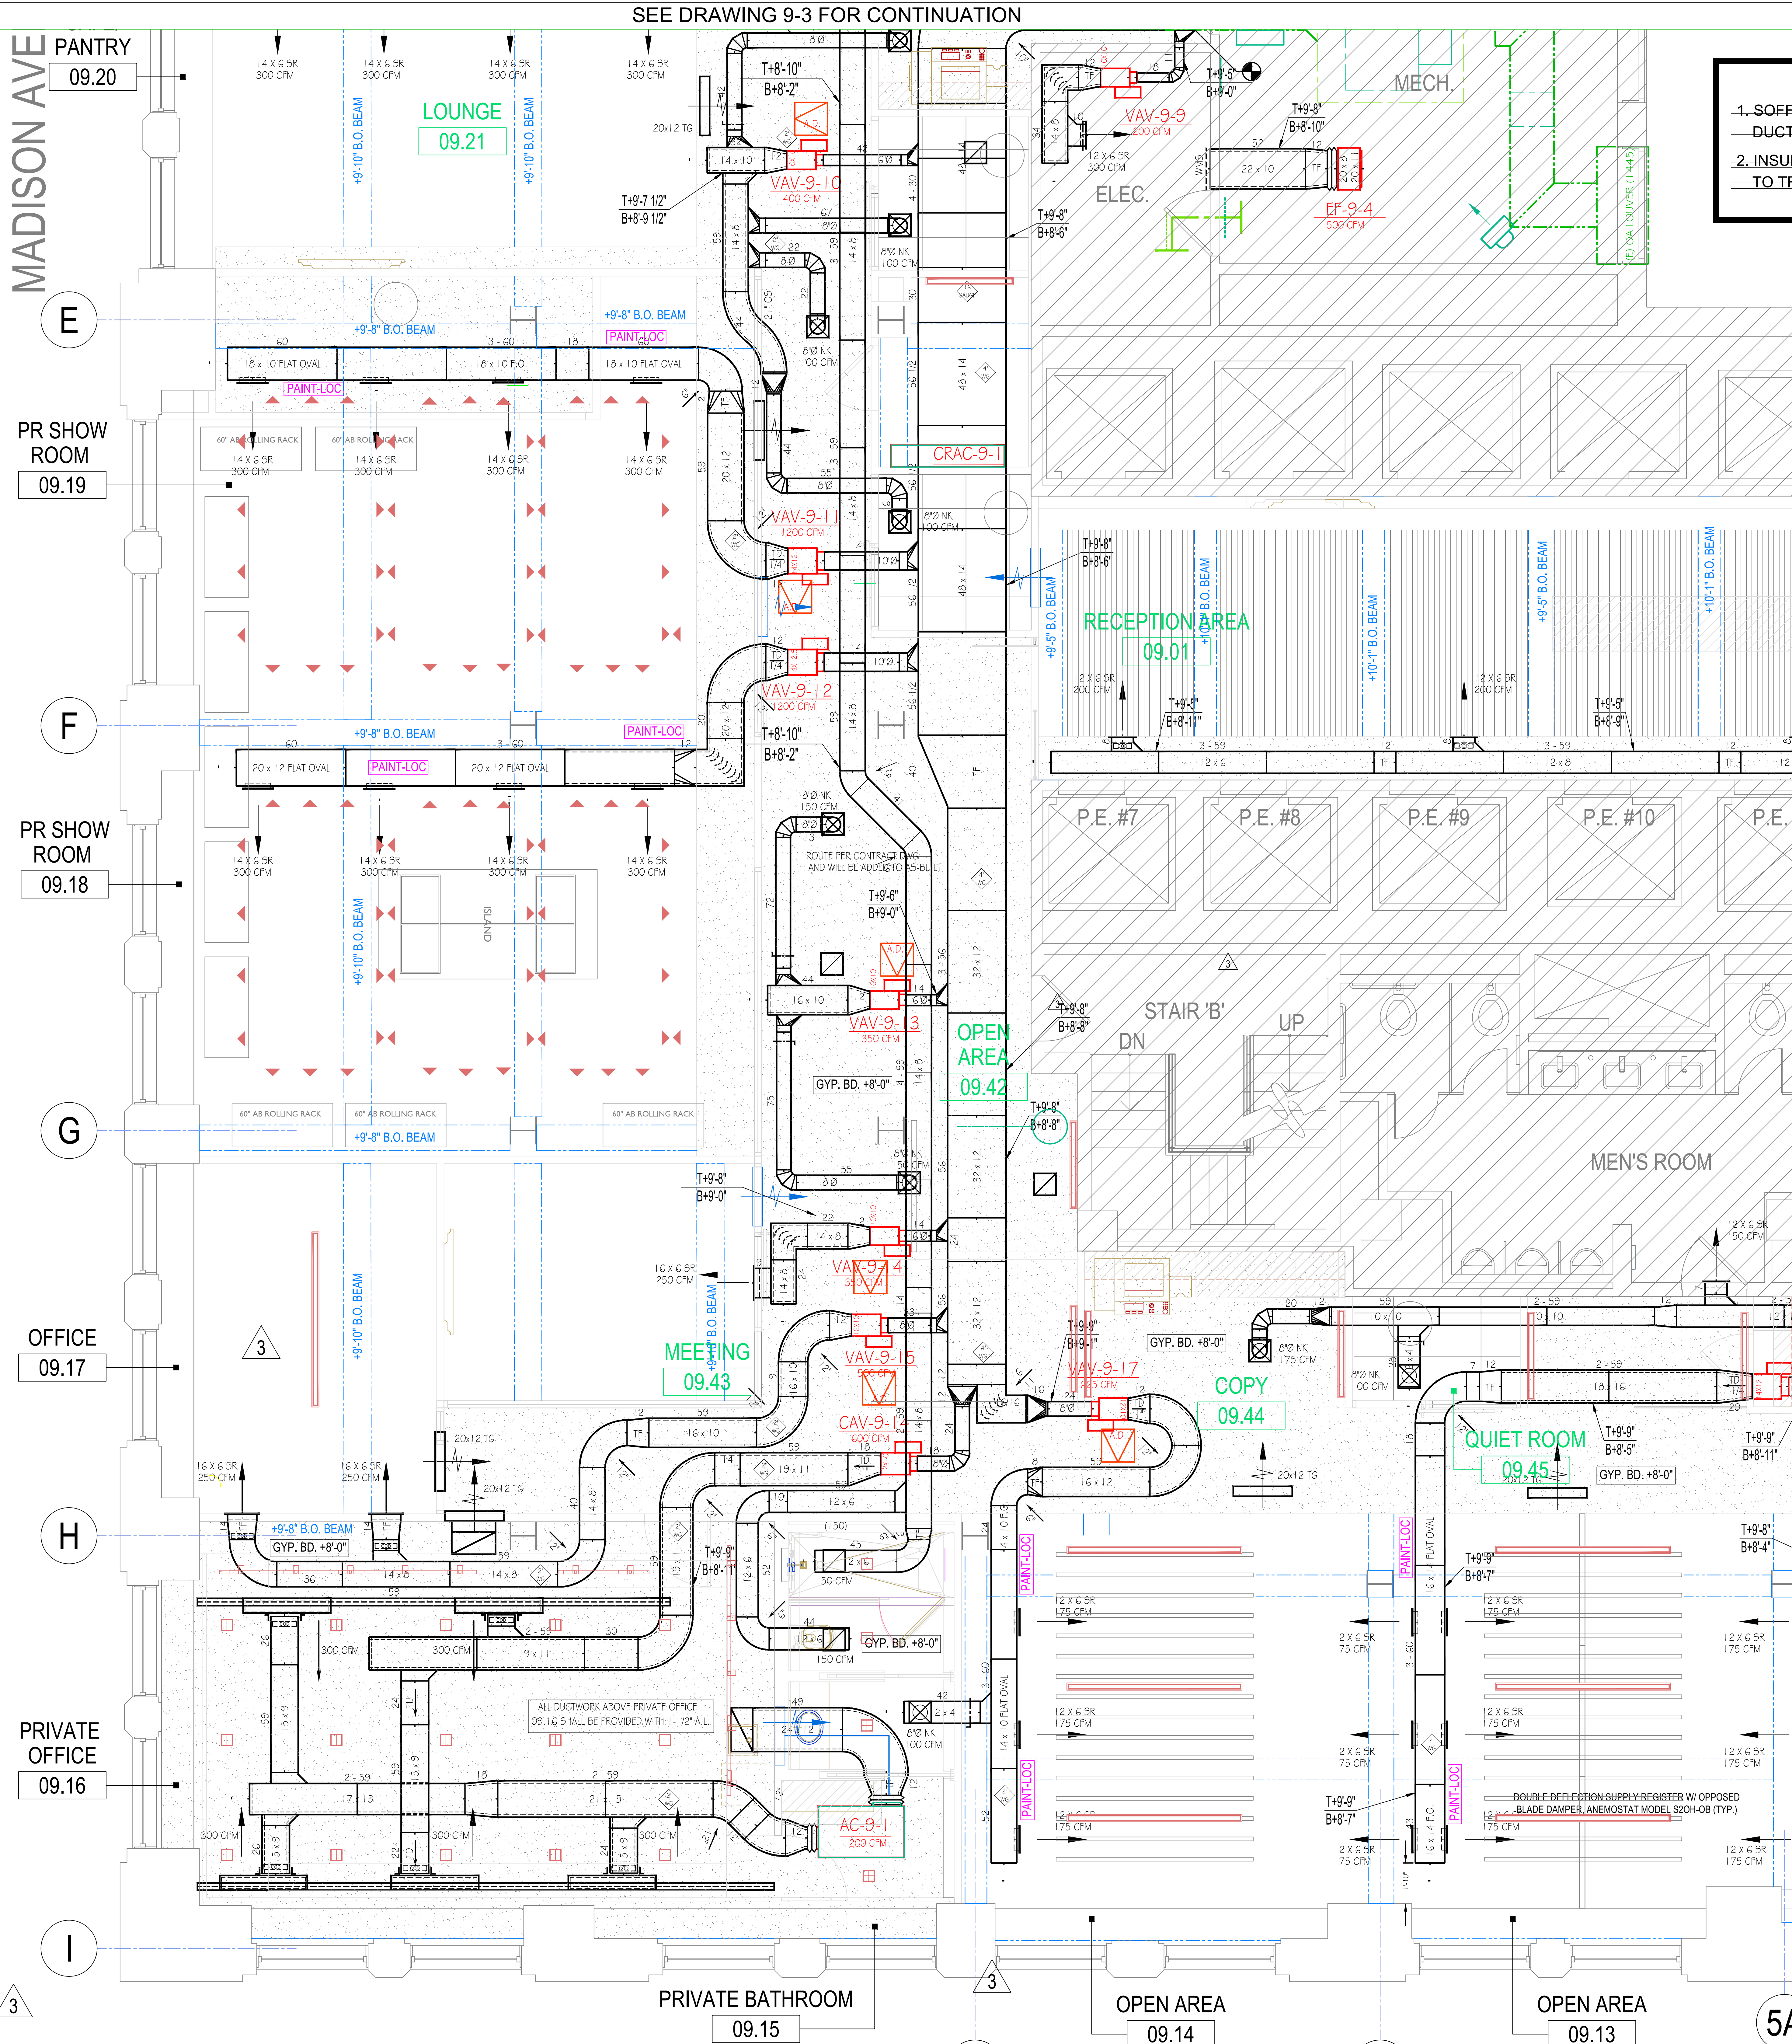

SEE DRAWING 9-1 FOR CONTINUATION

- CONFLICT NOTES TO ARCH/ENG'R
1. SOFFIT NEEDS TO BE INCREASED TO ALLOW PLACEMENT OF DUCTWORK AS SHOWN. (PLEASE ADVISE)

2. INSUFFICIENT CLEARANCE TO ROUTE EXHAUST DUCTWORK ADJACENT TO TRUNK DUCT ALONG CORRIDOR. (ENGINEER TO REVIEW)


ARCHITECT/ENGINEER & G.C. NOTE:
NO RESPONSE TO NOTE WILL BE INTERPRETED TO MEAN "CORRECT AS SHOWN".
INDICATES CEILING START POINT. REVISE IF NOT CORRECT AS SHOWN.
INDICATES CONFLICT OR ITEM WHERE CLARIFICATION IS REQUIRED.

KEY PLAN
FIRE SMOKE DAMPER MOTORIZED DAMPER

FIRE DAMPER CORD OPS.

DAMPER SCHEDULE
THIS DRAWING CONTAINS
PIECE NO. TO

NO. DATE
PIECE & NUMBER
SHOP RELEASE

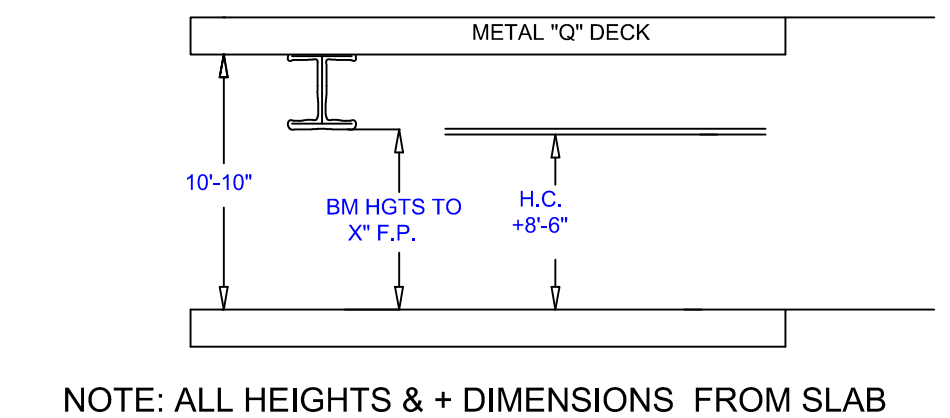

NOTE: ALL HEIGHTS & + DIMENSIONS FROM SLAB

TYPICAL SECTION

CUSTOMER

ARCHITECT
ENVIRONETICS ARCHITECTS
116 EAST 27TH STREET, NEW YORK, NY 10016

ENGINEER
RDA ENGINEERS
19 WEST 44TH STREET, NEW YORK, NY 10036

REFERENCE DRAWINGS			
DWG. NO.	DWG. DATE	LAST REV. NO.	REV. DATE

RECORD OF TRADE COORDINATION

TRADE	COMPANY	DATE	AUTHORIZED SIGNATURE
SHEET METAL			
HVAC			
PLUMBER			
SPRINKLER			
ELECTRICIAN			
GEN. CONTR.			
ENGINEER			
ARCHITECT			

LEGEND OF SYMBOLS

CONSTRUCTION AND MATERIALS	GALVANIZED	ALUM.	BLACK EXPOSED DUCT	STAINLESS
STANDARD				
ACOUSTIC LINING				
DUCT SIZES SHOWN ARE NOMINAL INTERIOR SIZES. DIMENSIONS ARE TO THE OUTSIDE OF DUCT. THEY DO NOT INCLUDE CLEARANCE ALLOWANCES FOR BRACING, STIFFENERS, CONNECTORS, HANGERS, SUPPORTS, ETC.				
ROUND DUCT ELEVATIONS ARE ALWAYS SHOWN TO BOTTOM OF DUCT.				
TOP OF DUCT TO UNDERSIDE OF SLAB ABOVE				
TOP OF DUCT TO UNDERSIDE OF SLAB ABOVE				
TOP OF DUCT TO UNDERSIDE OF SLAB ABOVE				

NO.	DATE	REVISION	BY/DATE
3	05-26-17	REVISED PER ADDENDUM #5 DATED 05-26-17	LF
2	05-16-17	REVISED PER ENGINEERS A.A.N. DATED 05-10-17	LF
1	05-06-17	REVISED PER ENGINEERS A.A.N. DATED 05-02-17	LF


SHOP DRAWING REVISIONS

AVALANCHE AIR ENTERPRISES, INC.
140 58TH STREET, BLDG A., UNIT 8E
BROOKLYN, NY 11220

TOMMY HILFIGER
285 MADISON AVENUE
NEW YORK, NEW YORK

TITLE	SCALE	DATE
9TH FLOOR DUCTWORK SHOP DRAWING	3/8"=1'-0"	10/22/17
DRAWN BY:	SCALE	DATE
JOB NO.	FLOOR	DWG. NO.
XXXX	9TH	9-2

PART PLAN - NINTH FLOOR
DECK HEIGHT +10'-8"

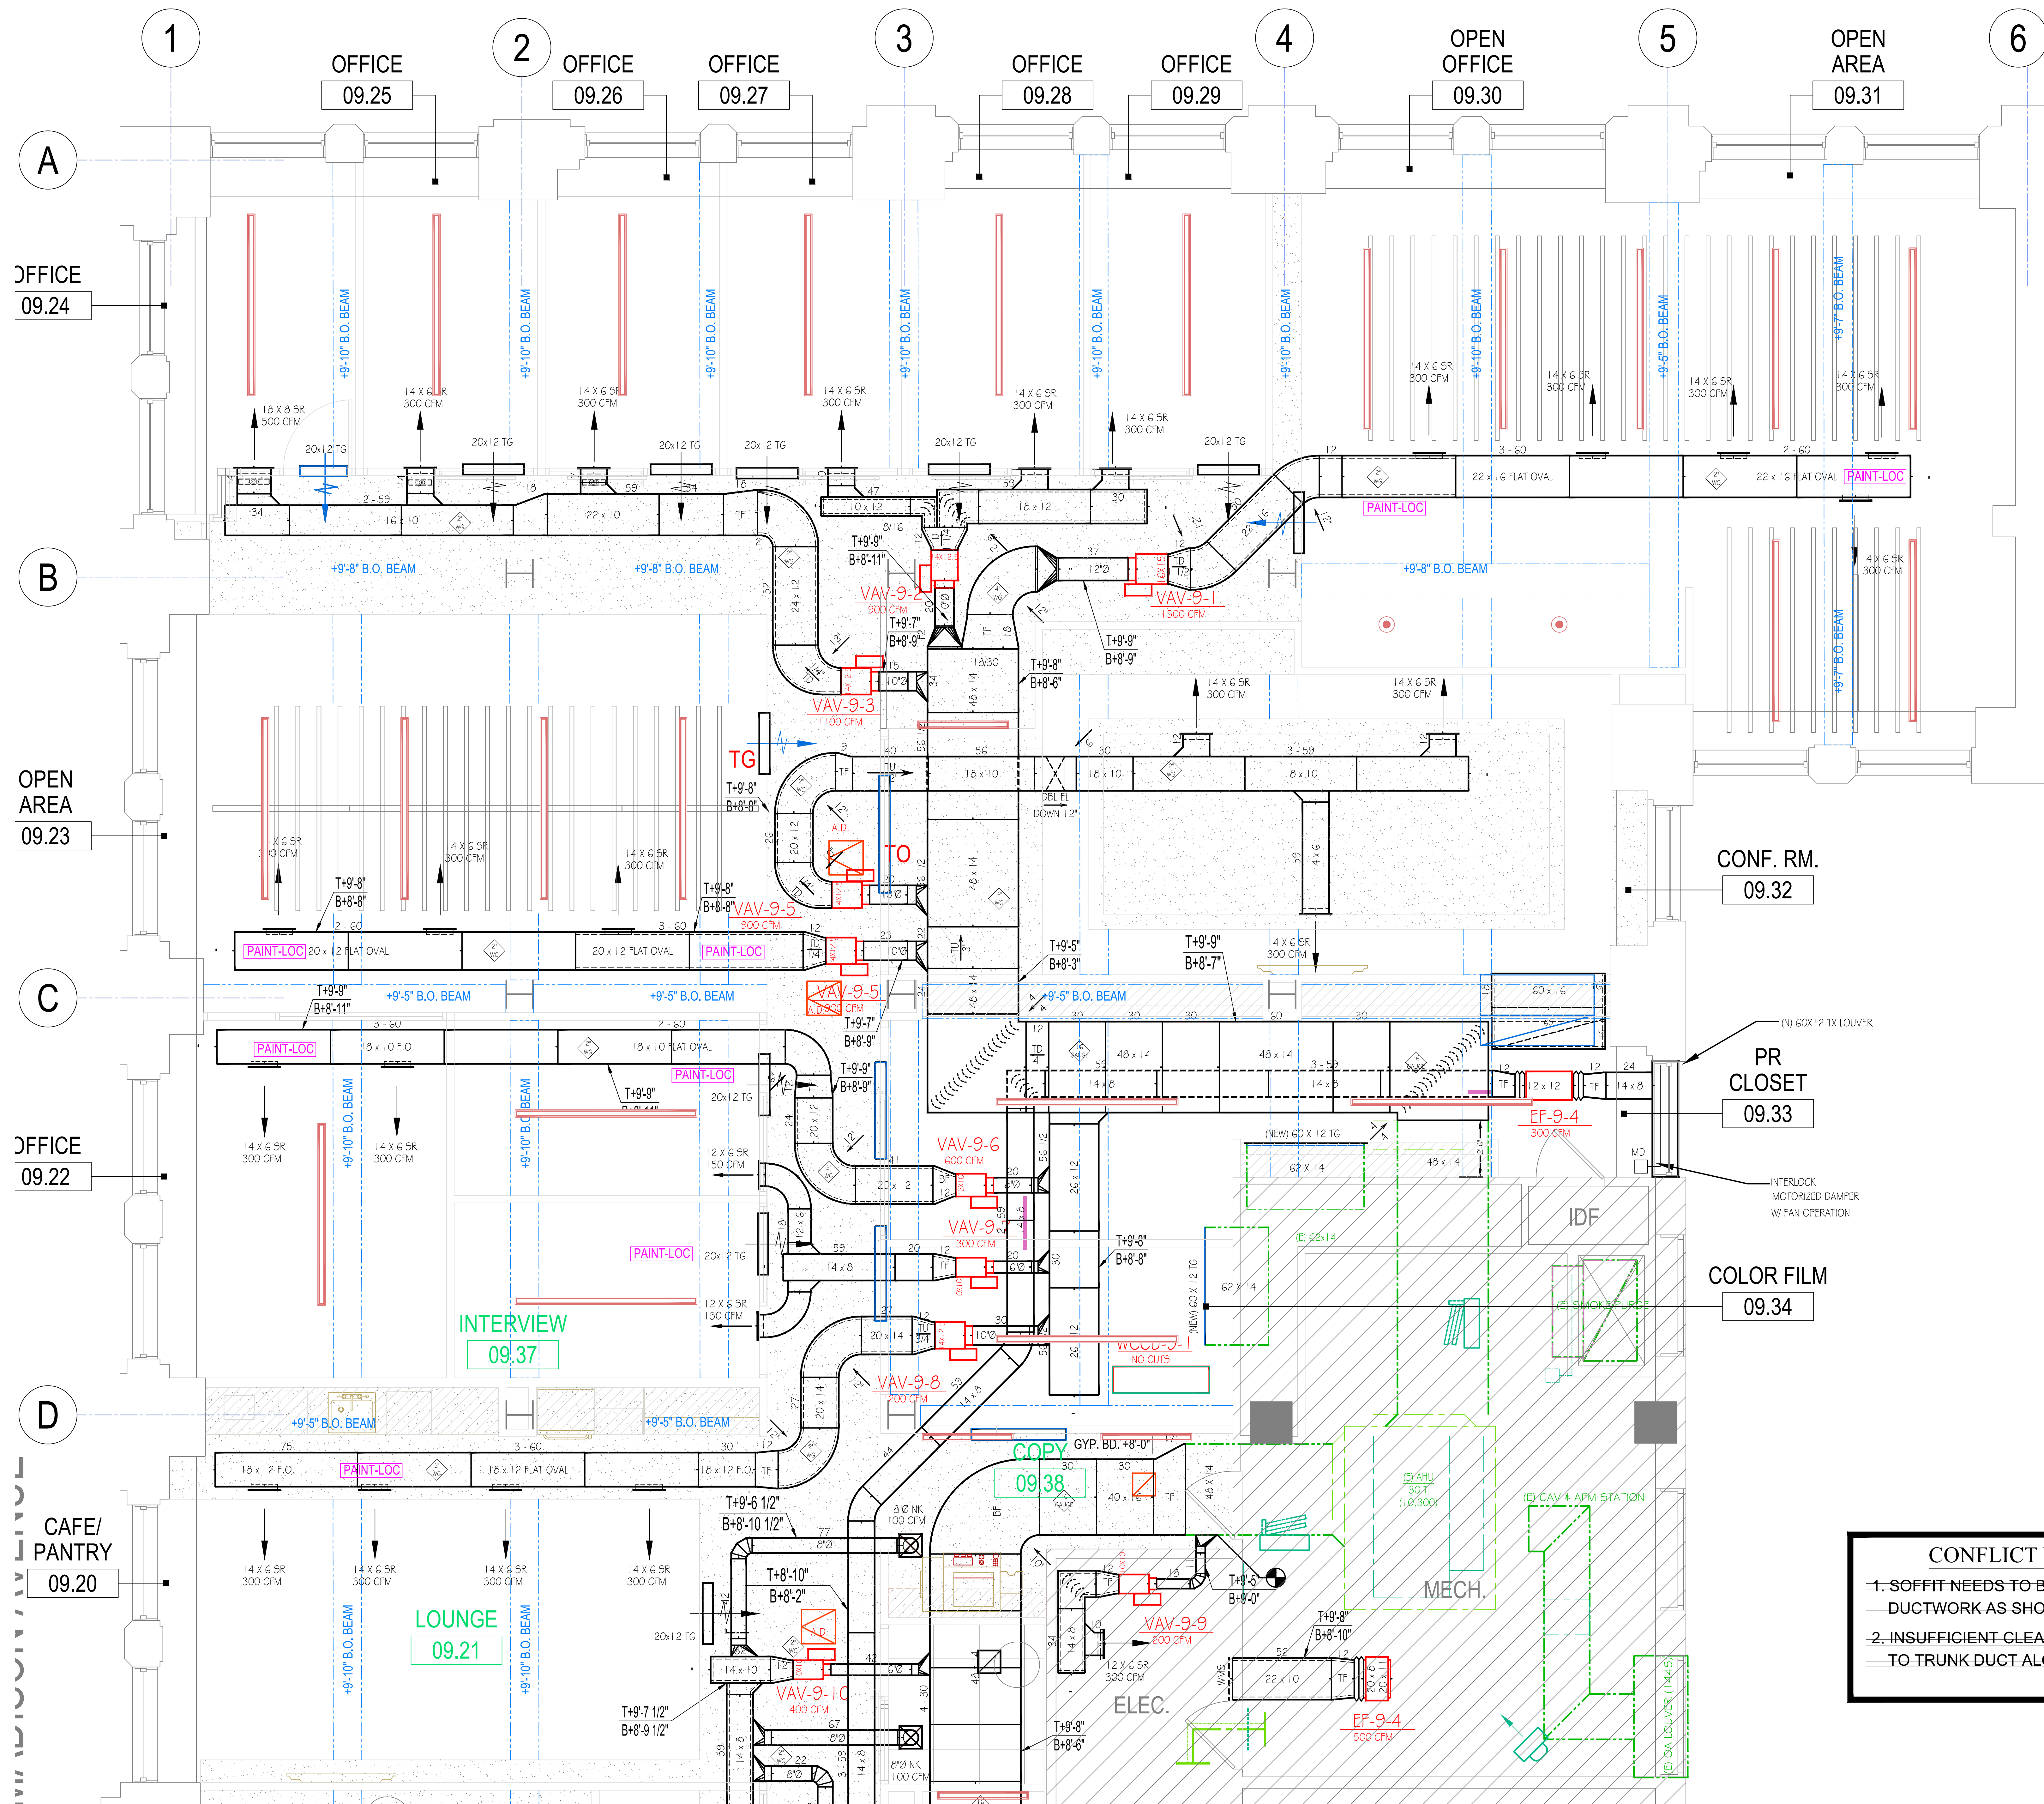

SEE DRAWING 9-2 FOR CONTINUATION

CONFLICT NOTES TO ARCH/ENG'R

1. SOFFIT NEEDS TO BE INCREASED TO ALLOW PLACEMENT OF DUCTWORK AS SHOWN. (PLEASE ADVISE)

2. INSUFFICIENT CLEARANCE TO ROUTE EXHAUST DUCTWORK ADJACENT TO TRUNK DUCT ALONG CORRIDOR. (ENGINEER TO REVIEW)

PART PLAN - NINTH FLOOR
DECK HEIGHT +10'-8"


ARCHITECT/ENGINEER & G.C. NOTE:
NO RESPONSE TO NOTE WILL BE INTERPRETED TO MEAN "CORRECT AS SHOWN"
INDICATES CEILING START POINT. REVISE IF NOT CORRECT AS SHOWN.
INDICATES CONFLICT OR ITEM WHERE CLARIFICATION IS REQUIRED.

KEY PLAN
FIRE SMOKE DAMPER MOTORIZED DAMPER

FIRE DAMPER CORD OPS.

DAMPER SCHEDULE
THIS DRAWING CONTAINS
PIECE NO. TO

NO. DATE
PIECE & NUMBER
SHOP RELEASE

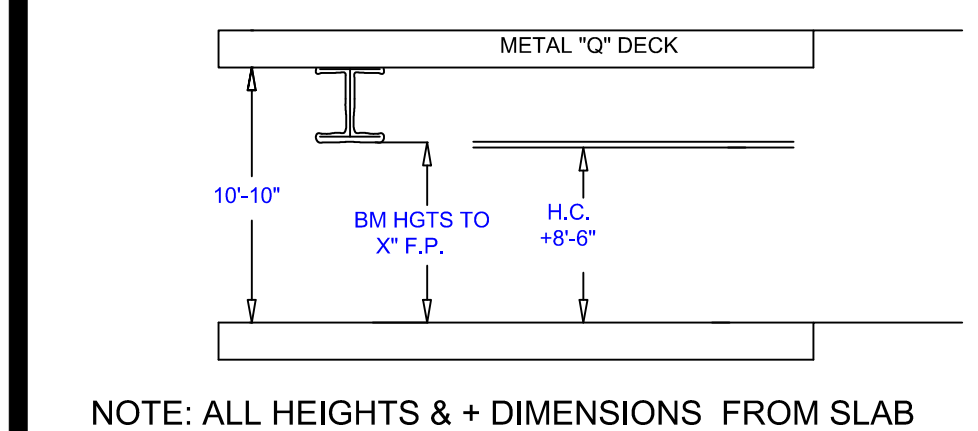

CUSTOMER

ARCHITECT
ENVIRONETICS ARCHITECTS
116 EAST 27TH STREET, NEW YORK, NY 10016

ENGINEER
RDA ENGINEERS
19 WEST 44TH STREET, NEW YORK, NY 10036

REFERENCE DRAWINGS			
DWG NO.	DWG DATE	LAST REV NO.	REV. DATE

RECORD OF TRADE COORDINATION			
TRADE	COMPANY	DATE	AUTHORIZED SIGNATURE
SHEET METAL			
HVAC			
PLUMBER			
SPRINKLER			
ELECTRICIAN			
GEN. CONTR.			
ENGINEER			
ARCHITECT			

LEGEND OF SYMBOLS			
CONSTRUCTION AND MATERIALS	GALVANIZED	ALUM.	BLACK EXPOSED DUCT
STANDARD			
ACOUSTIC LINING			
DUCT SIZES SHOWN ARE NOMINAL INTERIOR METAL DIMENSIONS. THEY DO NOT INCLUDE ALLOWANCES FOR BRACING, STIFFENERS, CONNECTORS, HANGERS, SUPPORTS, ETC.			
ROUND DUCT ELEVATIONS ARE ALWAYS SHOWN TO BOTTOM OF DUCT.			
TOP OF DUCT TO UNDERSIDE OF SLAB ABOVE			
TOP OF FINISH FLOOR TO BOTTOM OF DUCT			

2	05-16-17	REVISED PER ENGINEERS A.A.N. DATED 05-10-17	LF
1	05-06-17	REVISED PER ENGINEERS A.A.N. DATED 05-02-17	LF
NO.	DATE	REVISION	BY/DATE

AVALANCHE AIR ENTERPRISES, INC.
140 58TH STREET, BLDG. A, UNIT 8E
BROOKLYN, NY 11220

JOB
TOMMY HILFIGER
285 MADISON AVENUE
NEW YORK, NEW YORK

9TH FLOOR DUCTWORK SHOP DRAWING			
DRAWN BY:	SCALE: 3/8"=1'-0"	DATE: 10/22/17	
JOB NO.	FLOOR	DWG. NO.	
XXXX	9TH	9-3	